

Responsible: D. Rutz
Date: 24.10.2006


Tel.: (0209) 401 733
Fax: (0209) 401 743



EKE 60.2M

Replacing the touch control - spare-part no. 564525, old with spare-part number 531809

Contacts 30 and 31 of the touch control (spare-part no. 531809) have been modified and the cable connections are now too short. The cable harness enclosed must also be installed as a replacement. Once the repair has been carried out a VDE 0701 test must be carried out.

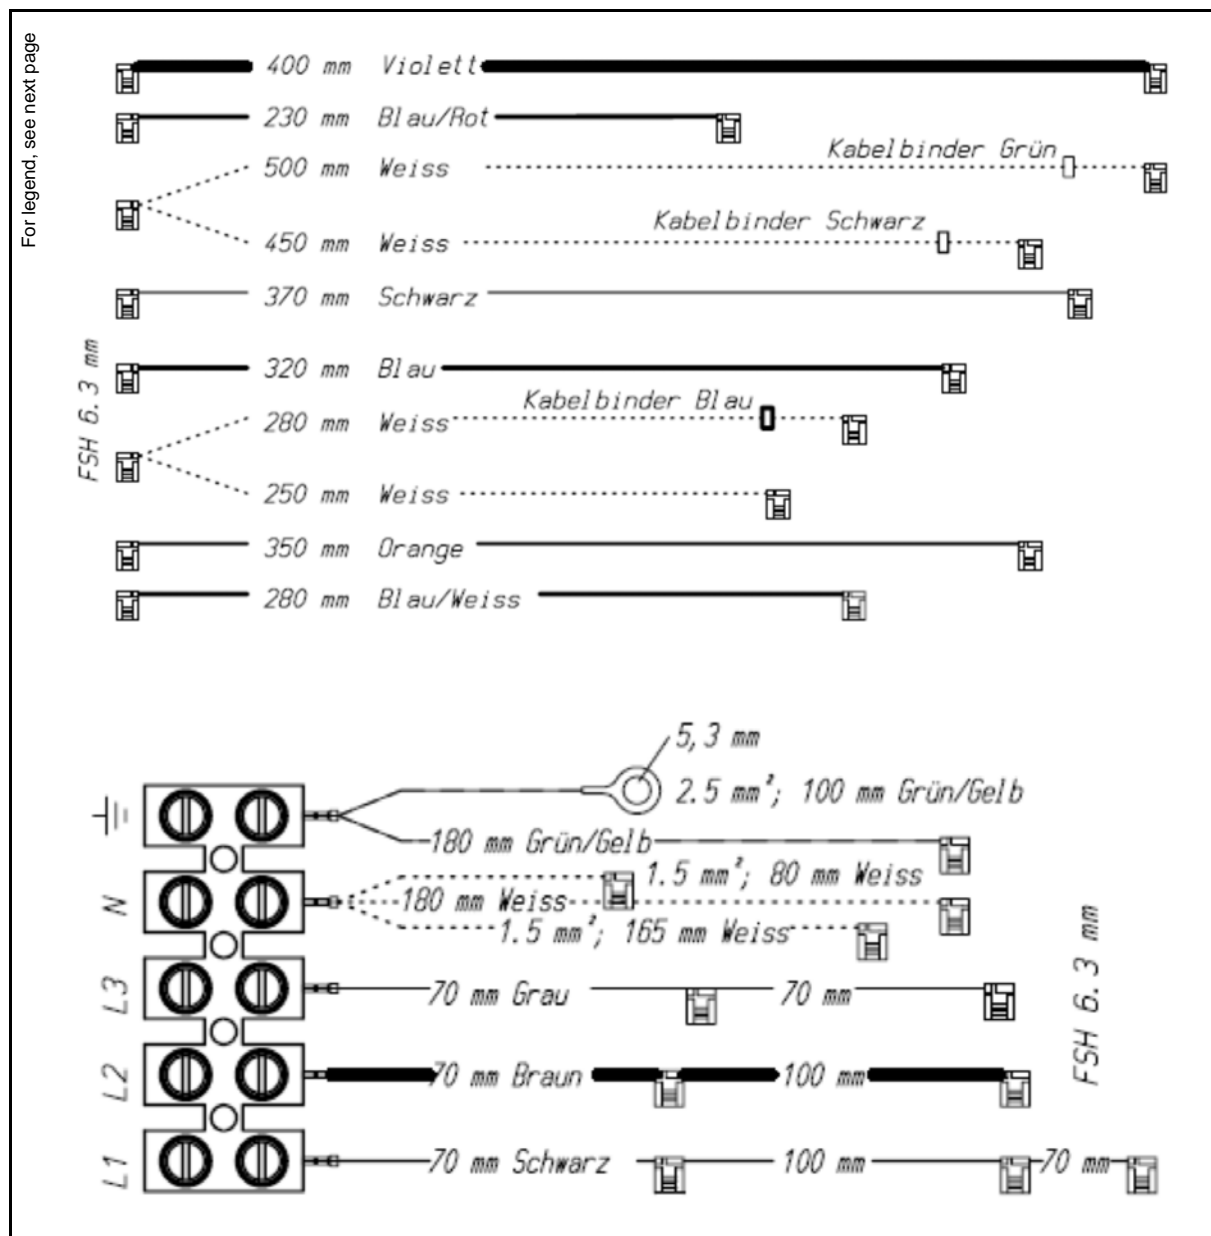

The circuit diagrams for EKE 60.2 (01-113214 and 01-123454) are available in the Internet.

Heizklemme	heater terminal
Gehäuse	housing
grün/gelb	green / yellow
weiß	white
blau	blue
schwarz	black
braun	brown
grau	grey
violett	violet
Kabelbinder grün	cable connector green
Kabelbinder schwarz	cable connector black
Kabelbinder blau	cable connector blue