


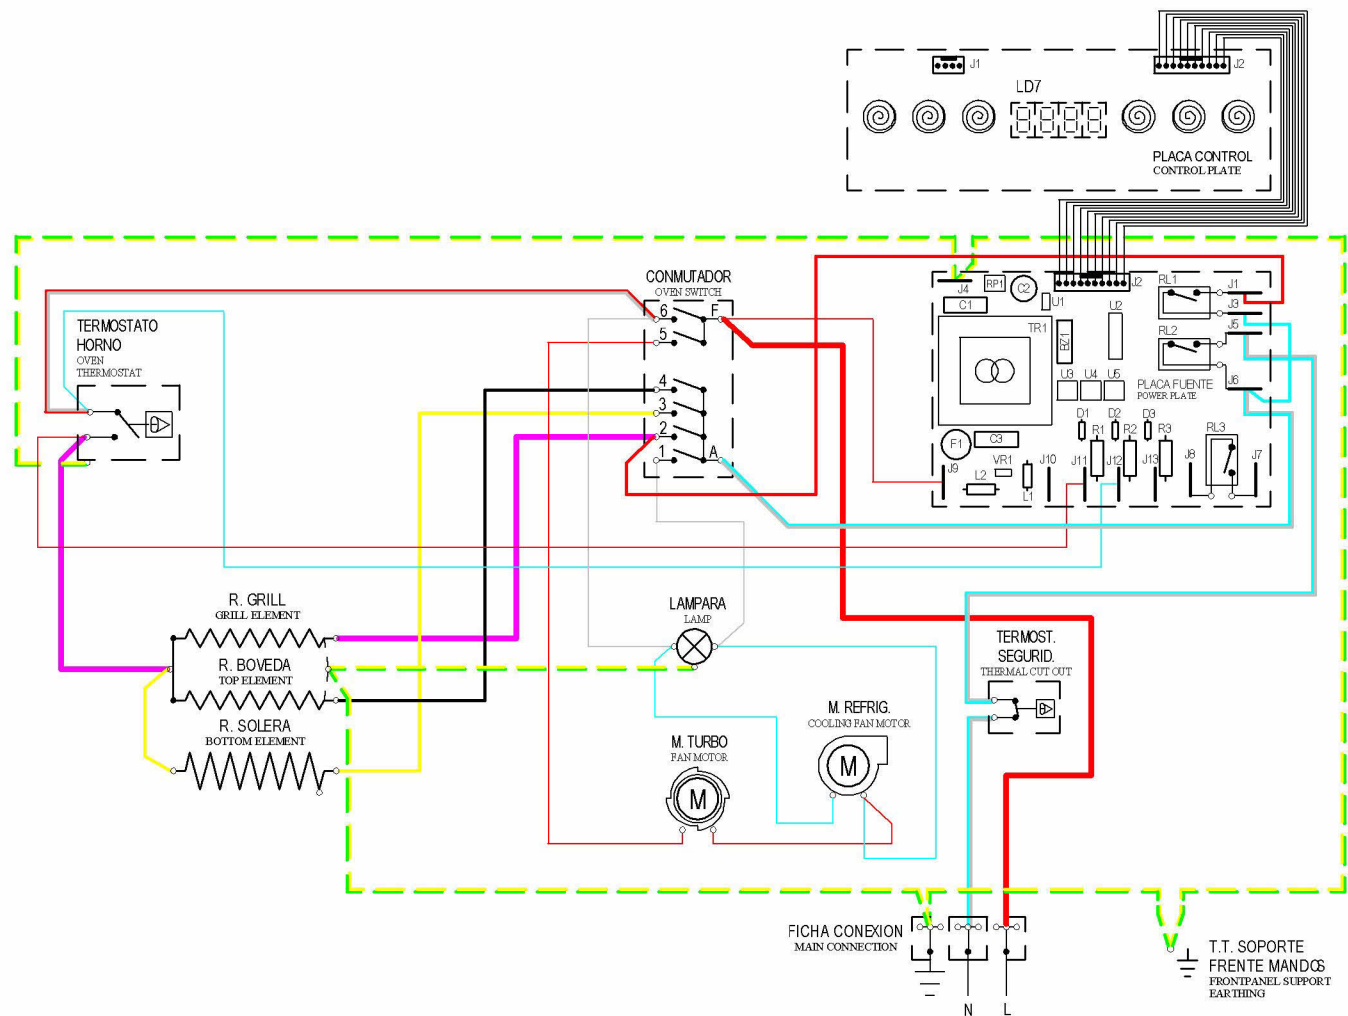

SÍMBOLO	DESIGNACIÓN
—	Cable sección: 1.5mm ²
—	Cable sección: 1.5mm ² (Toma tierra)
—	Cable sección: 1mm ²
—	Cable silicona + PV sección: 1mm ²
—	Cable sección: 0.5mm ²
—	Cable sección: 0.5mm ² T 250

CONMUTADOR 9P. Ref. 790601 "GOTTAK"									
	1	2	3	4	5	6	7	8	9
6 F	●	●	●	●	●	●	●	●	●
5	●	●	●	●	●	●	●	●	●
4	●	●	●	●	●	●	●	●	●
3	●	●	●	●	●	●	●	●	●
2	●	●	●	●	●	●	●	●	●
1 A	●	●	●	●	●	●	●	●	●

PATH :		TOLERANCIA GENERAL: $\pm$	
		Mat:	
ESCALA s / e	DIBUJADO:	FECHA:	NOMBRE:
	COMPROBADO:	17 03 08	M.A.
ESQUEMA ELECTRICO HX-740			Nº.: EE00310-000
Obs erv.: --			Sustituye a:
			Sustituido por:

teka TEKA INDUSTRIAL, S.A.
SANTANDER - ESPAÑA